





## Overview of Industrial Automatic Micro-Processor Control Systems

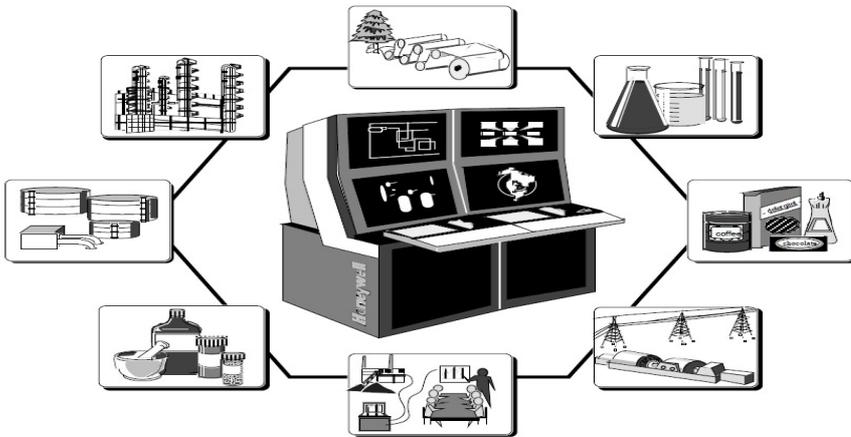

## Controller System for Industrial Automation

Reference:  
[www.pacontrol.com](http://www.pacontrol.com)

The element linking the measurement and the final control element is the controller. Before the advent of computers, the controllers are usually single-loop PID controllers. These are manufactured to execute PID control functions. These days, the controllers can do a lot more, however, easily 80 to 90% of the controllers are still PID controllers.

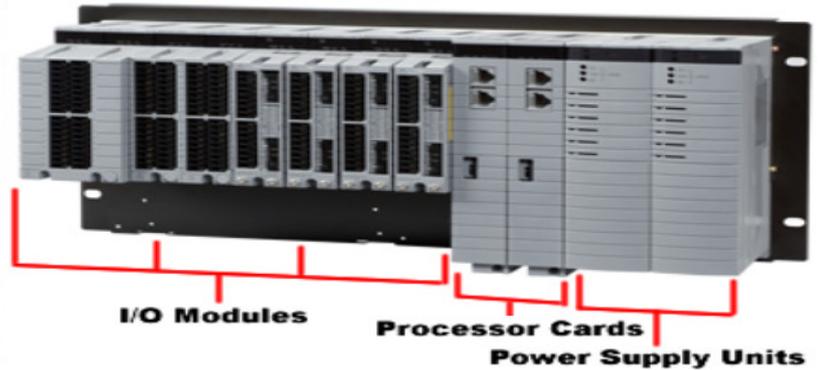

### Analogue vs Digital Controllers

It is indeed difficult to say that analogue controllers are definitely better than digital controllers. The point is, they both work. Analogue controllers are based on mechanical parts that cause changes to the process via the final control element. Again like final control elements, these moving parts are subjected to wear and tear over time and that causes the response of the process to be somewhat different with time. Analogue controllers control continuously.

Digital controllers do not have mechanical moving parts. Instead, they use processors to calculate the output based on the measured values. Since they do not have moving parts, they are not susceptible to deterioration with time. Digital controllers are not continuous. They execute at very high frequencies, usually 2-3 times a second.

Analogue controllers should not be confused with pneumatic controllers. Just because a controller is analogue does not mean it is pneumatic. Pneumatic controllers are those that use instrument air to pass measurement and controller signals instead of electronic signals. An analogue controller can use electronic signals. Compared to pneumatic controllers, electronic controllers (can be analogue or digital) have the advantage of not having the same amount of deadtime and lag due to the compressibility of the instrument air.



Free Download!  
Right-mouse click and select 'Save Target As ...' Process Control Systems 1.75Mb

## Basic Process Control Systems BPCS

### Distributed Control System (DCS)

The **DCS** is a control system which collects the data from the field and decides what to do with them. Data from the field can either be stored for future reference, used for simple process control, use in conjunction with data from another part of the plant for advanced control strategies.

What must be in the DCS for it to be able to do so much?

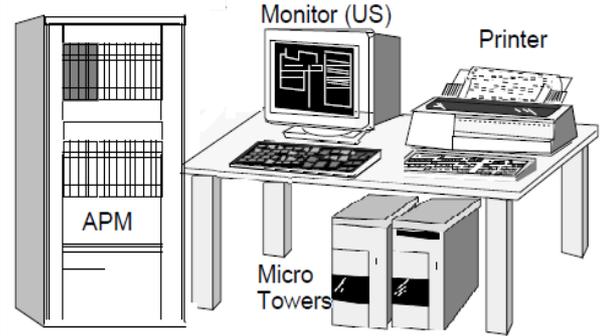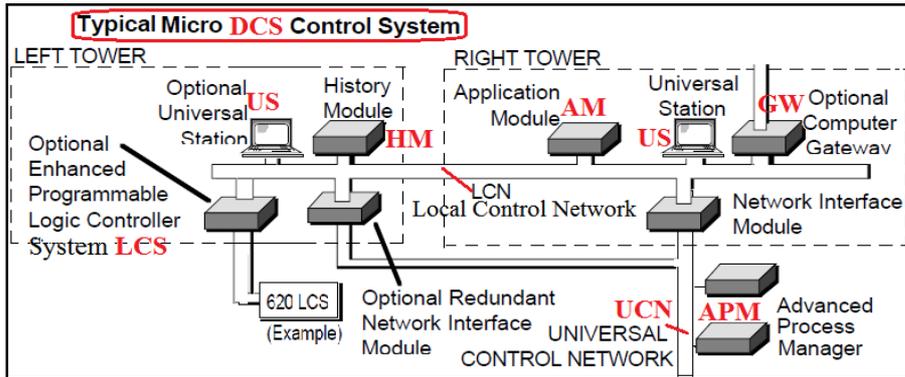

### Operator Console OC

These are like the monitors of our computers. They provide us with the feedback of what they are doing in the plant as well as the command we issue to the control system. These are also the places where operators issue commands to the field instruments.

### Engineering Station ES

These are stations for engineers to configure the system and also to implement control algorithms.

### History Module HM

This is like the harddisk of our PCs. They store the configurations of the DCS as well as the configurations of all the points in the plant. They also store the graphic files that are shown in the console and in most systems these days they are able to store some plant operating data.

### Data Historian DH

These are usually extra pieces of software that are dedicated to store process variables, set points and output values. They are usually of higher scanning rates than that available in the history module.

### Control Modules CM

These are like the brains of the DCS. Specially customized blocks are found here. These are customized to do control functions like PID control, ratio control, simple arithmetic and dynamic compensation. These days, advanced control features can also be found in them.

### I/O

These manage the input and output of the DCS. Input and output can be digital or analogues. Digital I/Os are those like on/off, start/stop signals. Most of the process measurements and controller outputs are considered analogue. These are the points where the field instruments are hard-wired to.

All above mentioned elements are connected by using a network, nowadays very often used is Ethernet.



The practical and technological boundaries between a Distributed Control System DCS, Programmable Logic Controller PLC and Personal Computer PC control are blurring. Systems traditionally associated with process control are being used in discrete applications. Likewise, traditionally discrete solutions are used increasingly in both batch and continuous process control.

Today's control hardware are constructed from many of the same standard industry components such as Intel processors. Therefore the only real difference between control systems is at the software level.

### أمثلة تطبيقية لنظم التحكم الصناعية

### ABB / Industrial IT - Advant Master DCS

Advant OCS (Open Control System) is an ABB solution for operators to improve their manufacturing productivity and achieve sustainable competitive advantages.

In 1992, based on the success of the Master systems in the 80's, the Master system began its evolution to Advant OCS. This evolution introduced high capacity controllers and I/O with an improved redundancy scheme. Also included were modern UNIX workstations, and in 1996 S800 I/O was added providing modular flexible remote I/O.



ABB Advant Master Control Systems



In 2000, Advant OCS with Master Software began its next step in the evolution process with the introduction of Industrial IT enabled products. ABB's commitment to protecting your investment continues with these enhancements by providing connectivity to our latest control offering.

A versatile and complete range of process I/O systems within the Advant family enables optimal user configurations:

- S100I/O - A rack-based I/O system for AC400 controllers
- S600I/O - A rack-based I/O system for AC100 controllers
- S800I/O - A highly modularized and flexible I/O-system

Numerous characteristics and functions facilitate and improve operation, monitoring, and reengineering of each process in a company. 800xA Operations (Process Portal) and the proven AdvaCommand for Unix solution (based on HP-UX) are available as an operator station for Advant OCS with Master Software.

The intuitive operator software provides consistent access and interaction with data from multiple control and I/O to plant and enterprise information.

## Honeywell Experion™ Process Knowledge System (PKS) أحدث جيل لديهم من نظم التحكم

Experion is Honeywell's unified system for process, business, and asset management that helps industrial manufacturers increase their profitability and productivity.

Experion takes customers well beyond Distributed Control System (DCS) functionality with an advanced automation platform solution and innovative application integration to improve business performance and peace of mind. And there's no need to worry about upgrading from TDC 2000®/TDC 3000® or TotalPlant® Solution (TPS).

The unique, patent pending design of Series C combines sleek styling and function to provide process I/O with reduced footprint, easier installation and maintenance, and longer life. The Series C form factor benefits extend to multiple modules, such as the Series C C300 Controller, the Fieldbus Interface Module, the Control Firewall, and HART analog modules.



Honeywell - Experion PKS

The Control Execution Environment (CEE) is the common core software used in the various controllers supported by Experion™. This includes the C200 Process Controller, the C300 Process Controller, the Application Control Environment (ACE) and the C200 Simulation Environment (SIM-C200). The CEE provides an execution and scheduling environment where control strategies are configured from a rich set of standard and optional function blocks using a single builder tool, Control Builder.

Function blocks are grouped and wired together in a container to perform a specific control function such as a valve control strategy. The Control Execution Environment (CEE) supports two types of containers: the Control Module in which continuous and discrete controls are combined; and an SCM, which is used for sequence control. Function blocks support the complete control application range, such as continuous, discrete and batch control.

## Emerson Process Management / DeltaV

DeltaV is the creation of Emerson Process Management's technological innovators, who worked in an off-site "out-of-the-box" think tank to build an automation system that could integrate and leverage today's digital world and cutting-edge technological innovations to make a value step-change in the process industries.

The name DeltaV is derived from the engineering equation for acceleration:  $dv/dt$ , the change in velocity over the change in time. The DeltaV system makes planning, engineering, installing, commissioning, training, operating, and maintaining your process EASY, which accelerates your success in improving your plant performance.



Emerson - DeltaV Hybrid Systems

The DeltaV system scales the complete range of applications from an isolated process area to a complete plant-wide automation system. Whether you need tens of I/O or tens of thousands of I/O-any size you want! The DeltaV system provides all the tools to manage your process easier than ever before.

The complete family of controllers is available to power your most advanced control strategies. Full controller and power supply redundancy is available for your mission-critical applications. The controller and I/O sub-system is rated for Class I, Division 2 and Zone 2 environments to reduce your installation costs.

DeltaV workstations are based on the latest Intel-based

microprocessors running the Microsoft Windows XP /Windows 2003 operating system. A complete range of applications is provided to cover system configuration, operator interface, engineering, maintenance, and integration functions.

The DeltaV control network—a high-speed Ethernet LAN—provides system communications and connects the various system nodes. The control network can be fully redundant. DeltaV remote services extend the operations, engineering, and diagnostic applications across your enterprise network.

Unlike PLC/HMI solutions, the completely integrated DeltaV system features a single database that coordinates all configuration activities. System configuration is globally distributed in the run-time environment.




## Programmable Logic Controller PLC

A **PROGRAMMABLE LOGIC CONTROLLER (PLC)** is an industrial computer control system that continuously monitors the state of input devices and makes decisions based upon a custom program, to control the state of devices connected as outputs.

Almost any production line, machine function or process can be automated using a PLC. The speed and accuracy of the operation can be greatly enhanced using this type of control system. But the biggest benefit in using a PLC is the ability to change and replicate the operation or process while collecting and communicating vital information.

A PLC consists of following main parts:

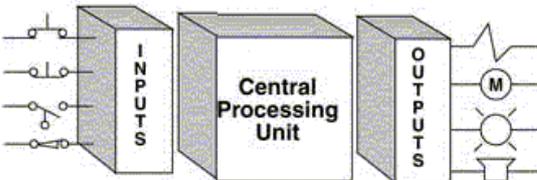

### What is a PLC input/output?

#### INPUT



Sensing Devices  
Switches and Pushbuttons  
Proximity Sensors  
Limit Switches  
Pressure Switches

#### OUTPUT

Valves  
Solenoids  
Motor  
Actuators  
Pumps

### PLC Operations consist of four steps

1. Input Scan: Scans the state of the Inputs
2. Program Scan: Executes the program logic
3. Output Scan: Energize/de-energize the output
4. Housekeeping

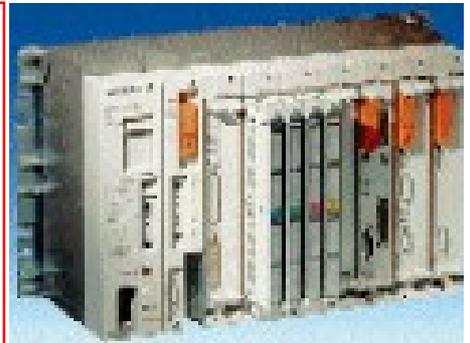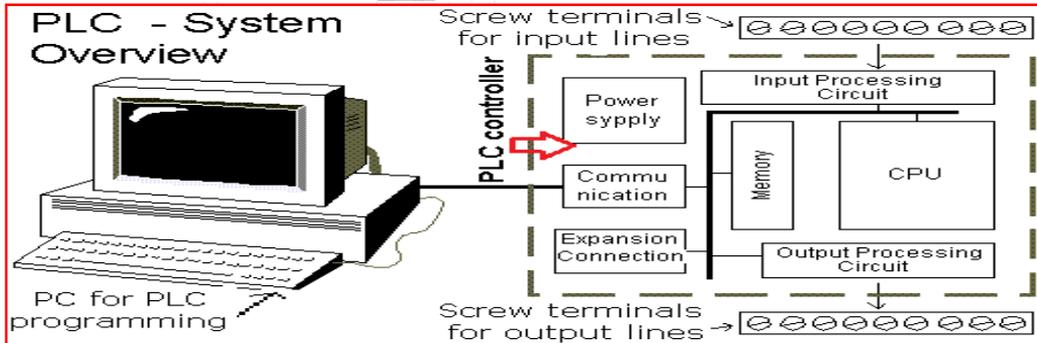

### Free PLC Programming Tutorial and Examples

Web site contains general information about PLC Command Instructions and explains how they function in your application program. These Commands are based on Allen Bradley's SLC-500 PLC and their RSLogix-500 Software.

Each of the command instructions include information on

- Specifications for the instruction
- How to use the instruction
- An example program application

The following support materials are available as free downloads in PDF format from the PLC website <http://www.industrialtext.com>

#### PLC Primer ( 252K PDF file)

For those new to PLCs--Grasp the basics of PLCs

#### Programming and Documentation Pads (ALL) (720K PDF file)

These useful PLC listing pads allow you to implement better PLC design implementations and keep an orderly documentation system. Select a PDF with all listing and sample pads or individual listings with samples (below)

#### PLC Program Listing (184K PDF file)

#### Input/Output Listing (200K PDF file)

#### Register-Word/Internal Output Usage Listing (196K PDF file)

#### PLC Automation Project Notes (168K PDF file)

#### PLC Glossary of Terms (92K PDF file)

A complete glossary of the most often used terms in PLC systems

#### Logic Symbols, Truth Tables and Equivalent Ladder/PLC Logic Diagrams (20K PDF file)

Handy table of equivalent electromechanical ladder diagram and PLC symbols

#### Electrical Relay Diagram and P&ID Symbols (88K PDF file)

Reference table of relay and P&ID diagram symbols used in design

#### What is PLC Ladder Logic?

### Rockwell Automation AB - SLC 500 PLC

The SLC 500 family is a growing family of small programmable controllers built around two hardware options: a fixed controller or a modular controller. The modular controller offers you maximum flexibility in system configuration. With its multiple processor choices, numerous power supply options and extensive I/O capacity, the modular SLC 500 controller allows you to create a system specifically designed for your application.

The fixed controller provides the power supply, inputs and outputs, and processor in one unit. It also offers a 2-slot expansion chassis for increased flexibility. The programming tools and most I/O modules are compatible between the two hardware options, so you can cost effectively solve a broad range of applications.



### Allen-Bradley SLC 500 Processors



### PLC-5 / 1771 Controller System

PLC-5 processors are available in a large range of forcible I/O (512 maximum through 3072 maximum) and maximum user memory (6K through 100K words). All are capable of controlling remotely-located I/O. The maximum number of I/O locations ranges from 5 through 125.

A PLC-5 processor communicates across the 1771 backplane to 1771 I/O modules in the chassis in which the processor resides. A PLC-5 processor can communicate with I/O across a DeviceNet or Universal Remote I/O link. Selected models of PLC-5 processors can communicate with I/O across a ControlNet or Extended Local I/O link. I/O adapters for 1771 I/O are available for ControlNet, Universal Remote I/O, and Extended Local I/O links. General communication messages can be sent from or received by PLC-5 processors across DeviceNet, ControlNet, or Ethernet networks, as well as Data Highway Plus, RS-232-C, RS-422-A, or RS-423-A networks. You can add a DeviceNet port to any PLC-5 processor with a 1771-SDN scanner module. Each Ethernet PLC-5 processor has an on-board Ethernet port, and you can add an Ethernet port to any PLC-5 processor with a 1785-ENET Ethernet Interface Module.



Allen-Bradley  
PLC-5 Family

### Siemens Simatic PLC's - Simatic S7

SIMATIC S7 lets you implement an array of different technologies with integrated solutions.

It is easy to parameterize functions in the TIA range, using the interactive screen forms embedded in STEP 7.

The STEP 7 basic package already includes blocks for control tasks. These blocks can be loaded onto any CPU. In the field of microautomation, STEP 7-Micro/WIN also offers a user-friendly assistant for programming technological functions.

For the count, measure, control and position processes, there are CPUs available featuring the technological functions as an integral part of the operating system.

The technological tasks are executed by way of the inputs and outputs directly integrated on the CPU.

The Technology CPUs 315T and 317T integrate performant PLCopen-certified technology and motion control functions right into the standard SIMATIC CPU.



Siemens Simatic S7-300

### Simatic ET200S

SIMATIC ET 200S is the distributed I/O station that guarantees lasting savings in life-cycle costs with the highest flexibility. Installation couldn't be easier and the bit-modular design of the ET 200S enables multifunctional use of the station.

The multifunctional ET200S can now communicate over PROFINET as well as over PROFIBUS, giving the proven and field-tested I/O station all the advantages of Ethernet communication. PROFIBUS-DP is the fastest, most standardised network at field level. It has been standardised in accordance with the European Norm EN 50170. PROFIBUS is completely integrated in the new SIMATIC world, both in terms of hardware and software.

Modules for the ET 200S include power modules, digital or analog input and output modules, technology modules and motor starters. The ET200S is also equipped for fail-safe signal modules and motor starters. Completely new is the ET 200S frequency converter, which makes it possible to perform variable-speed drive tasks for up to 4 kW power.

The SIMATIC ET 200 distributed I/O system makes it possible to connect digital and analog inputs/outputs with the central controller. ET 200 also allows to use intelligent I/O modules in distributed configurations.

Terminal modules with FastConnect technology that needs no stripping of cables help minimize rewiring time.



Siemens Simatic ET200

Siemens PLC Training - Step 7  
Siemens PLC Training - PCS 7  
Siemens Simatic HMI WinCC  
Siemens Simatic Hardware and Software Configuration

## Supervisory Control And Data Acquisition SCADA

Following we describe the SCADA systems in terms of their architecture, their interface to the process hardware, the functionality and the application development facilities they provide.

SCADA systems have made substantial progress over the recent years in terms of functionality, scalability, performance and openness such that they are an alternative to in house development even for very demanding and complex control systems.

What does SCADA mean?

SCADA stands for Supervisory Control And Data Acquisition. As the name indicates, it is not a full control system, but rather focuses on the supervisory level. As such, it is a purely software package that is positioned on top of hardware to which it is interfaced, in general via Programmable Logic Controllers (PLC's), or other commercial hardware modules.



SCADA systems are used not only in industrial processes: e.g. steel making, power generation (conventional and nuclear) and distribution, chemistry, but also in some experimental facilities such as nuclear fusion. The size of such plants range from a few 1000 to several 10 thousands input/output (I/O) channels. However, SCADA systems evolve rapidly and are now penetrating the market of plants with a number of I/O channels of several 100 thousands I/O's

SCADA systems used to run on DOS, VMS and UNIX; in recent years all SCADA vendors have moved to NT, Windows XP, Windows Server 2003 and some also to Linux.


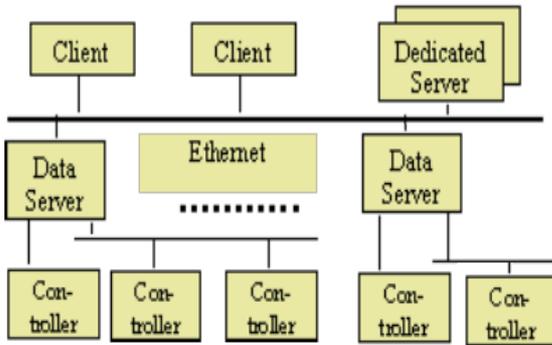


Figure 1: Typical Hardware Architecture

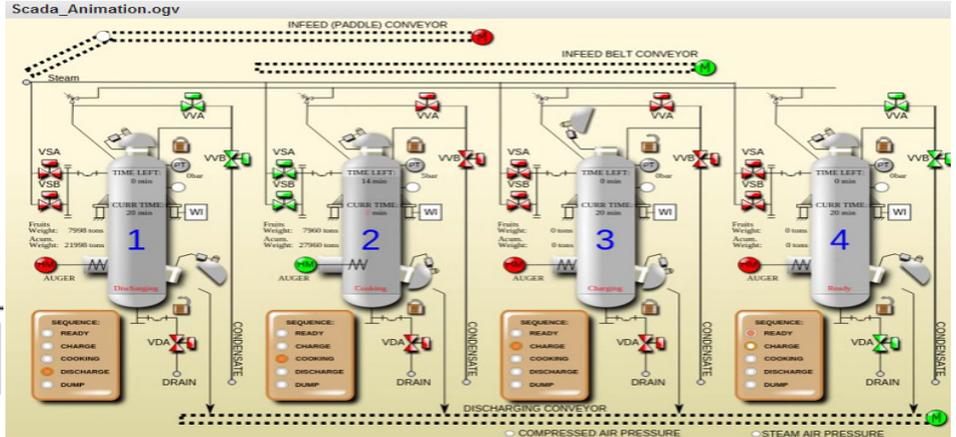

## 1. Architecture

This section describes the common features of the SCADA products.

### Hardware Architecture

One distinguishes two basic layers in a SCADA system: the "client layer" which caters for the man machine interaction and the "data server layer" which handles most of the process data control activities. The data servers communicate with devices in the field through process controllers. Process controllers, e.g. PLC's, are connected to the data servers either directly or via networks or fieldbuses that are proprietary (e.g. Siemens H1), or non-proprietary (e.g. Profibus). Data servers are connected to each other and to client stations via an Ethernet LAN.

### Software Architecture

The products are multi-tasking and are based upon a real-time database (RTDB) located in one or more servers. Servers are responsible for data acquisition and handling (e.g. polling controllers, alarm checking calculations, logging and archiving) on a set of parameters, typically those they are connected to.

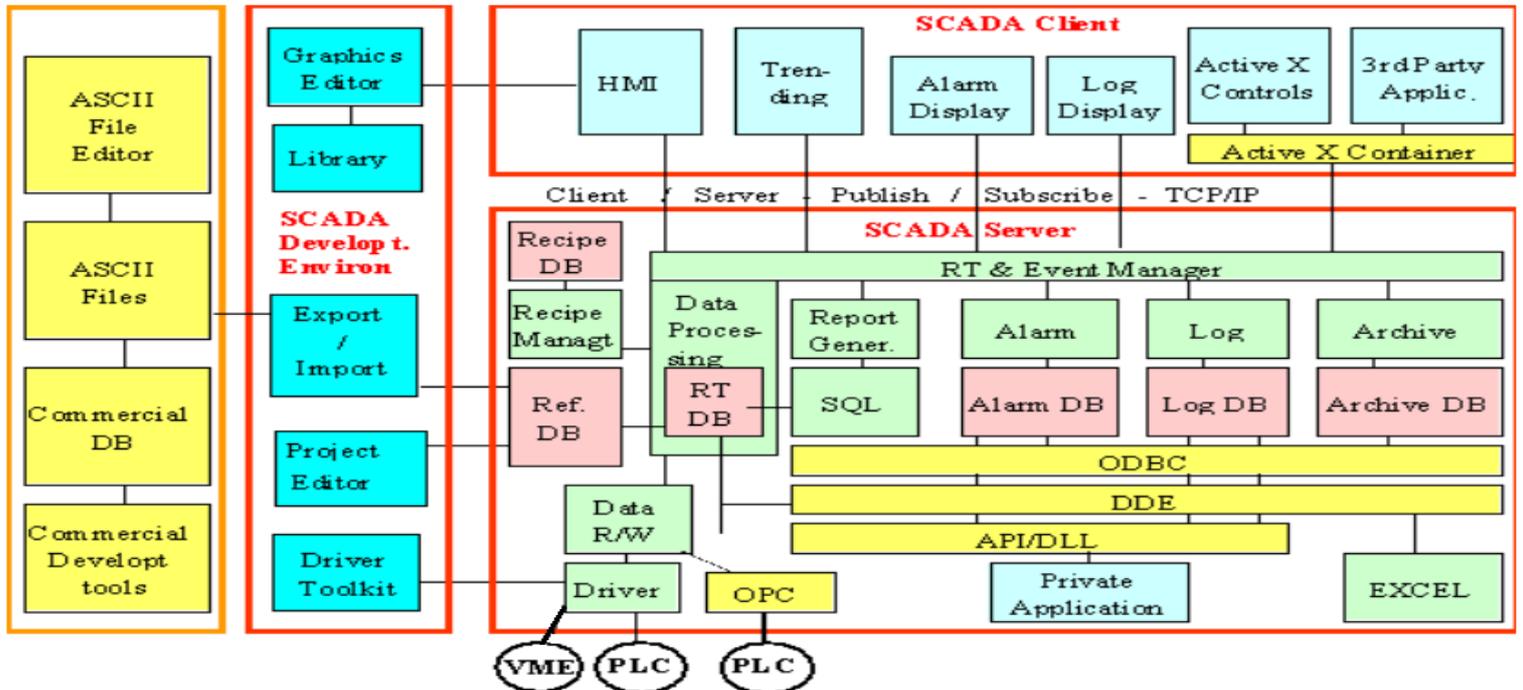


Figure 2: Generic Software Architecture

However, it is possible to have dedicated servers for particular tasks, e.g. historian, datalogger, alarm handler. The figure above shows a generic SCADA software architecture.



## Communications

### Internal Communication:

Server-client and server-server communication is in general on a publish-subscribe and event-driven basis and uses a TCP/IP protocol, i.e., a client application subscribes to a parameter which is owned by a particular server application and only changes to that parameter are then communicated to the client application.

### Access to Devices

The data servers poll the controllers at a user defined polling rate. The polling rate may be different for different parameters. The controllers pass the requested parameters to the data servers. Time stamping of the process parameters is typically performed in the controllers and this time-stamp is taken over by the data server. If the controller and communication protocol used support unsolicited data transfer then the products will support this too.

The products provide communication drivers for most of the common PLC's and widely used field-buses, e.g., Modbus. Some of the drivers are based on third party products (e.g., Applicom cards) and therefore have additional cost associated with them. VME on the other hand is generally not supported.

A single data server can support multiple communications protocols: it can generally support as many such protocols as it has slots for interface cards.

The effort required to develop new drivers is typically in the range of 2-6 weeks depending on the complexity and similarity with existing drivers, and a driver development toolkit is provided for this.

## Interfacing

### Application Interfaces / Openness:

The provision of OPC client functionality for SCADA to access devices in an open and standard manner is developing. There still seems to be a lack of devices/controllers, which provide OPC server software, but this improves rapidly as most of the producers of controllers are actively involved in the development of this standard.

The products also provide an Open Data Base Connectivity (ODBC) interface to the data in the archive/logs, but not to the configuration database, an ASCII import/export facility for configuration data, a library of APIs supporting C, C++, and Visual Basic (VB) to access data in the RTDB, logs and archive. The API often does not provide access to the product's internal features such as alarm handling, reporting, trending, etc.

The PC products provide support for the Microsoft standards such as Dynamic Data Exchange (DDE) which allows e.g. to visualize data dynamically in an EXCEL spreadsheet, Dynamic Link Library (DLL) and Object Linking and Embedding (OLE).

### Database

The configuration data are stored in a database that is logically centralised but physically distributed and that is generally of a proprietary format.

For performance reasons, the RTDB resides in the memory of the servers and is also of proprietary format.

The archive and logging format is usually also proprietary for performance reasons, but some products do support logging to a Relational Data Base Management System (RDBMS) at a slower rate either directly or via an ODBC interface.

## Scalability

Scalability is understood as the possibility to extend the SCADA based control system by adding more process variables, more specialized servers (e.g. for alarm handling) or more clients. The products achieve scalability by having multiple data servers connected to multiple controllers. Each data server has its own configuration database and RTDB and is responsible for the handling of a sub-set of the process variables (acquisition, alarm handling, archiving).

## Redundancy

The products often have built in software redundancy at a server level, which is normally transparent to the user. Many of the products also provide more complete redundancy solutions if required.

## 2. Functionality

### Access Control

Users are allocated to groups, which have defined read/write access privileges to the process parameters in the system and often also to specific product functionality.

### MMI

The products support multiple screens, which can contain combinations of synoptic diagrams and text. They also support the concept of a "generic" graphical object with links to process variables. These objects can be "dragged and dropped" from a library and included into a synoptic diagram.



Most of the SCADA products that were evaluated decompose the process in "atomic" parameters (e.g. a power supply current, its maximum value, its on/off status, etc.) to which a Tag-name is associated. The Tag-names used to link graphical objects to devices can be edited as required. The products include a library of standard graphical symbols, many of which would however not be applicable to the type of applications encountered in the experimental physics community.

Standard windows editing facilities are provided: zooming, re-sizing, scrolling... On-line configuration and customization of the MMI is possible for users with the appropriate privileges. Links can be created between display pages to navigate from one view to another.

### **Trending**

The products all provide trending facilities and one can summarize the common capabilities as follows:

- the parameters to be trended in a specific chart can be predefined or defined on-line
- a chart may contain more than 8 trended parameters or pens and an unlimited number of charts can be displayed (restricted only by the readability)
- real-time and historical trending are possible, although generally not in the same chart
- historical trending is possible for any archived parameter
- zooming and scrolling functions are provided
- parameter values at the cursor position can be displayed

The trending feature is either provided as a separate module or as a graphical object (ActiveX), which can then be embedded into a synoptic display. XY and other statistical analysis plots are generally not provided.

### **Alarm Handling**

Alarm handling is based on limit and status checking and performed in the data servers. More complicated expressions (using arithmetic or logical expressions) can be developed by creating derived parameters on which status or limit checking is then performed. The alarms are logically handled centrally, i.e., the information only exists in one place and all users see the same status (e.g., the acknowledgement), and multiple alarm priority levels (in general many more than 3 such levels) are supported.

It is generally possible to group alarms and to handle these as an entity (typically filtering on group or acknowledgement of all alarms in a group). Furthermore, it is possible to suppress alarms either individually or as a complete group. The filtering of alarms seen on the alarm page or when viewing the alarm log is also possible at least on priority, time and group. However, relationships between alarms cannot generally be defined in a straightforward manner. E-mails can be generated or predefined actions automatically executed in response to alarm conditions.

### **Logging/Archiving**

The terms logging and archiving are often used to describe the same facility. However, logging can be thought of as medium-term storage of data on disk, whereas archiving is long-term storage of data either on disk or on another permanent storage medium. Logging is typically performed on a cyclic basis, i.e., once a certain file size, time period or number of points is reached the data is overwritten. Logging of data can be performed at a set frequency, or only initiated if the value changes or when a specific predefined event occurs. Logged data can be transferred to an archive once the log is full. The logged data is time-stamped and can be filtered when viewed by a user. The logging of user actions is in general performed together with either a user ID or station ID. There is often also a VCR facility to play back archived data.

### **Report Generation**

One can produce reports using SQL type queries to the archive, RTDB or logs. Although it is sometimes possible to embed EXCEL charts in the report, a "cut and paste" capability is in general not provided. Facilities exist to be able to automatically generate, print and archive reports.

### **Automation**

The majority of the products allow actions to be automatically triggered by events. A scripting language provided by the SCADA products allows these actions to be defined. In general, one can load a particular display, send an Email, run a user defined application or script and write to the RTDB.

The concept of recipes is supported, whereby a particular system configuration can be saved to a file and then re-loaded at a later date.

Sequencing is also supported whereby, as the name indicates, it is possible to execute a more complex sequence of actions on one or more devices. Sequences may also react to external events.



### 3. Application Development

#### Configuration

The development of the applications is typically done in two stages. First the process parameters and associated information (e.g. relating to alarm conditions) are defined through some sort of parameter definition template and then the graphics, including trending and alarm displays are developed, and linked where appropriate to the process parameters. The products also provide an ASCII Export/Import facility for the configuration data (parameter definitions), which enables large numbers of parameters to be configured in a more efficient manner using an external editor such as Excel and then importing the data into the configuration database.

However, many of the PC tools now have a Windows Explorer type development studio. The developer then works with a number of folders, which each contains a different aspect of the configuration, including the graphics.

The facilities provided by the products for configuring very large numbers of parameters are not very strong. However, this has not really been an issue so far for most of the products to-date, as large applications are typically about 50k I/O points and database population from within an ASCII editor such as Excel is still a workable option.

Online modifications to the configuration database and the graphics are generally possible with the appropriate level of privileges.

#### Development Tools

The following development tools are provided as standard:

- Graphics Editor, with standard drawing facilities including freehand, lines, squares circles, etc. It is possible to import pictures in many formats as well as using predefined symbols including e.g. trending charts, etc. A library of generic symbols is provided that can be linked dynamically to variables and animated as they change. It is also possible to create links between views so as to ease navigation at run-time.
- Database Configuration Tool (usually through parameter templates). It is in general possible to export data in ASCII files so as to be edited through an ASCII editor or Excel.
- Scripting Language
- Application Program Interface (API) supporting C, C++, VB
- Driver Development Toolkit to develop drivers for hardware that is not supported by the SCADA product.

#### Object Handling

The products in general have the concept of graphical object classes, which support inheritance. In addition, some of the products have the concept of an object within the configuration database. In general the products do not handle objects, but rather handle individual parameters, e.g., alarms are defined for parameters, logging is performed on parameters, and control actions are performed on parameters. The support of objects is therefore fairly superficial.

### 4. Evolution

SCADA vendors release one major version and one to two additional minor versions once per year. These products evolve thus very rapidly so as to take advantage of new market opportunities, to meet new requirements of their customers and to take advantage of new technologies.

As was already mentioned, most of the SCADA products that were evaluated decompose the process in "atomic" parameters to which a Tag-name is associated. This is impractical in the case of very large processes when very large sets of Tags need to be configured. As the industrial applications are increasing in size, new SCADA versions are now being designed to handle devices and even entire systems as full entities (classes) that encapsulate all their specific attributes and functionality. In addition, they will also support multi-team development.

As far as new technologies are concerned, the SCADA products are now adopting:

- Web technology, ActiveX, Java, etc.
- OPC as a means for communicating internally between the client and server modules. It should thus be possible to connect OPC compliant third party modules to that SCADA product.

### 5. Engineering

Whilst one should rightly anticipate significant development and maintenance savings by adopting a SCADA product for the implementation of a control system, it does not mean a "no effort" operation. The need for proper engineering can not be sufficiently emphasized to reduce development effort and to reach a system that complies with the requirements, that is economical in development and maintenance and that is reliable and robust. Examples of engineering activities specific to the use of a SCADA system are the definition of:

- A library of objects (PLC, device, subsystem) complete with standard object behavior (script, sequences, ...), graphical interface and associated scripts for animation
- Templates for different types of "panels", e.g. alarms
- Instructions on how to control e.g. a device ...
- A mechanism to prevent conflicting controls (if not provided with the SCADA)
- Alarm levels, behavior to be adopted in case of specific alarms, ...



### Ivensys - Wonderware / Intouch

InTouch® 9.0 software with SmartSymbols and the IOSetRemoteReferences script function enables users to quickly and easily create and deploy graphical representations of real-time industrial process applications that connect to InTouch tag servers, ArchestrA® Object Templates in Wonderware's Industrial Application Server and I/O Servers.


With SmartSymbols, users can very easily create graphic templates that can be used throughout the entire application. Users can create a graphical object once, attach animations and then save that object as a SmartSymbol. Users can also create standard libraries of SmartSymbols that adhere to their company's standards for color and animation, resulting in graphics that conform to existing practices without requiring a great deal of administration and management. These libraries of SmartSymbols can be exported and imported into other InTouch applications resulting in standards for graphics that can be easily implemented throughout an entire organization. Developing entire InTouch HMI applications becomes as simple as choosing the SmartSymbol graphic from the library manager, selecting the instance reference and dropping it into a window.

When testing applications or modifying graphical objects, users only need to edit the SmartSymbol graphic template and all instances throughout the application will be automatically updated with the new information, resulting in tremendous time savings and a significant reduction in potential errors.

In addition, the IOSetRemoteReferences script function enables users to create graphical faceplates, which can be quickly modified at runtime. Faceplates can be created to model devices and their controls used throughout the application such as valves, pumps and motors. To leverage the IOSetRemoteReferences script function, a user would first create a SmartSymbol graphic template and then associate it with tags using a remote style reference. At runtime, whenever a particular condition occurs or a device such as a push of a button is activated, the IOSetRemoteReferences function updates all of the data references. This update is very fast because all of the data sources in the window are updated using one line of script.

### GE Fanuc - Intellution / iFIX

Proficy HMI/SCADA - iFIX is a powerful Client/Server based HMI/SCADA solution that provides process visualization, data acquisition and supervisory control over manufacturing and production processes. Proficy HMI/SCADA - iFIX gives Operators and Process Engineers the power and security to precisely monitor and control every aspect of their process, equipment and resources. The result is a faster response to production issues, with improved quality, reduced waste, faster time-to-market and increased profitability.

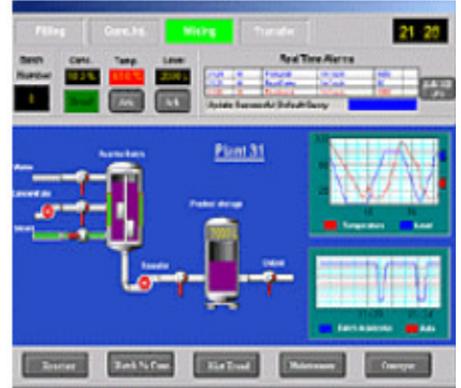

Wonderware- Intouch



Intellution- iFIX

**Powerful Distributed Client/Server Architecture**  
Collects, processes and distributes real-time data with unparalleled flexibility and scalability. The Proficy HMI/SCADA - iFIX architecture enables users to leverage multiple clients, including iClient TS - a solution that leverages Microsoft Terminal Server technology to seamlessly extend the reach of your HMI/SCADA applications.

**Faster system development and deployment**  
The Intellution WorkSpace delivers point-and-click simplicity to application development. Through the use of powerful yet easy-to-use Wizards, Proficy HMI/SCADA - iFIX dramatically accelerates the development process. In addition, Intellution's Animation Experts drive internal third-party ActiveX control without VBA Programming.

**Simplified application integration**  
Through Proficy HMI/SCADA - iFIX's patented Secure Containmentment technology, you can fully leverage third-party applications within the Proficy HMI/SCADA - iFIX environment... and do so without compromising your system's reliability.

**Enhanced security and accountability**  
Proficy HMI/SCADA - iFIX boasts powerful new security and eSignature capabilities, designed to enable access restriction at a very granular level, as well as deliver a vehicle for capturing complete audit trail information - outstanding functionality for businesses in the regulated industries or for any company who simply wants to enhance security.

\*\*\*\*\* End of file \*\*\*\*\*

أ.م/ محسن سيد سليمان

مدير معمل التحكم ACC ومسئول إدارة دبلوم التحكم الأوتوماتيكي  
مدير وحدة ضمان الجودة سابقاً ومرشداً أكاديمي د.ع في قسم ميكانيكا قوى